



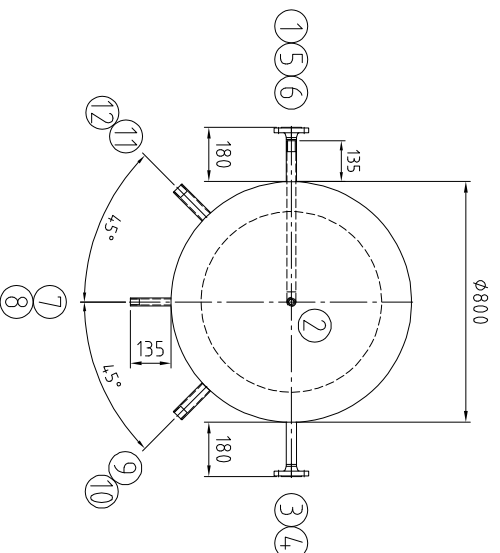

Kippmaß: 2020

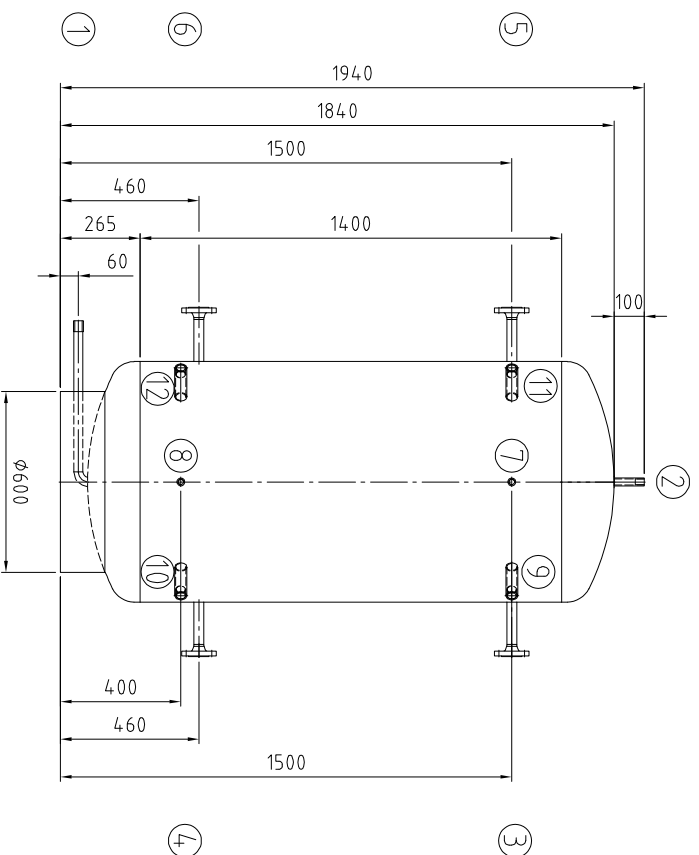

Handwritten signature
ISO 9001
 Attest Group SA
 Dorem des Mécaniques 5
 1032 Roubaix - France

Min./max. zul. Druck (pS) 0 / 3 bar
 Min./max. zul. Temperatur (TS) 0 / 109 °C
 Min./max. allow. temperature (PT) 4,5 bar
 Prüfdruck (PT) 4,5 bar
 Volumen Capacity (V) 800 L
 Oberflächenbehandlung Surface treatment gebleicht und passiviert / pickled and passivated
 Werkstoff material 1.4571 / 1.4404
 Gewicht Weight 125 kg
 Artikel-Nr. Article number
 Kategorie/Modul DGR 2014/68/EU Category/module PED 2014/68/EU Art. 4, Abs. (3)

12	Thermometer	Rp 1"	DN 2986				
11	Thermometer	Rp 1"	DN 2986				
10	Thermometer	Rp 1"	DN 2986				
9	Muffenanschluss / socket connection	Rp 1"	DN 2986				
8	Thermometer	Rp 1/2"	DN 2986				
7	Thermometer	Rp 1/2"	DN 2986				
6	Flanshschluss / flange connection	25	40	EN 1092-1/1			
5	Flanshschluss / flange connection	25	40	EN 1092-1/1			
4	Flanshschluss / flange connection	25	40	EN 1092-1/1			
3	Flanshschluss / flange connection	25	40	EN 1092-1/1			
2	Entlüftung	Rp 1"	DN 2986				
1	Entlüftung	Rp 3/4"	DN 2986				
Stutzen	Benennung	DN	PN	Norm	Dichtfläche	Position	Rohrmaßung
Nozle	Denomination			Standard	Facings	Position	Dimension

RevZ	12.01.2026	Riedel	Benker	Änderung gemäß Kundenwunsch / change according to customer request
Rev1	16.12.2025	Altmanhofer	Wihan	Änderung laut Kundenwunsch / Change according to customer request
Index	Datum/date	Gez./drawn	Gepr./appr	Art der Änderung / Modification
	10.12.2025	Altmanhofer		

Gez. / drawn Wihan
 Gepr. / appr. Wihan
 Benennung / Designation:
 Typ RET 800 special



Zeichnung Nr. / Drawing No.: Projekt Nr. / Project No.:
 23409-0 RevZ P2500860_3
 Bestell-Nr. / Order No.: Maßstab / Scale
 KST300/123853 1:12.5
 Blatt / sheet Blatt / sheet
 1/1 1/1
 Stand/as per: Stand/as per:
 12.01.2026 12.01.2026